


CORP "B"



CORP "A"

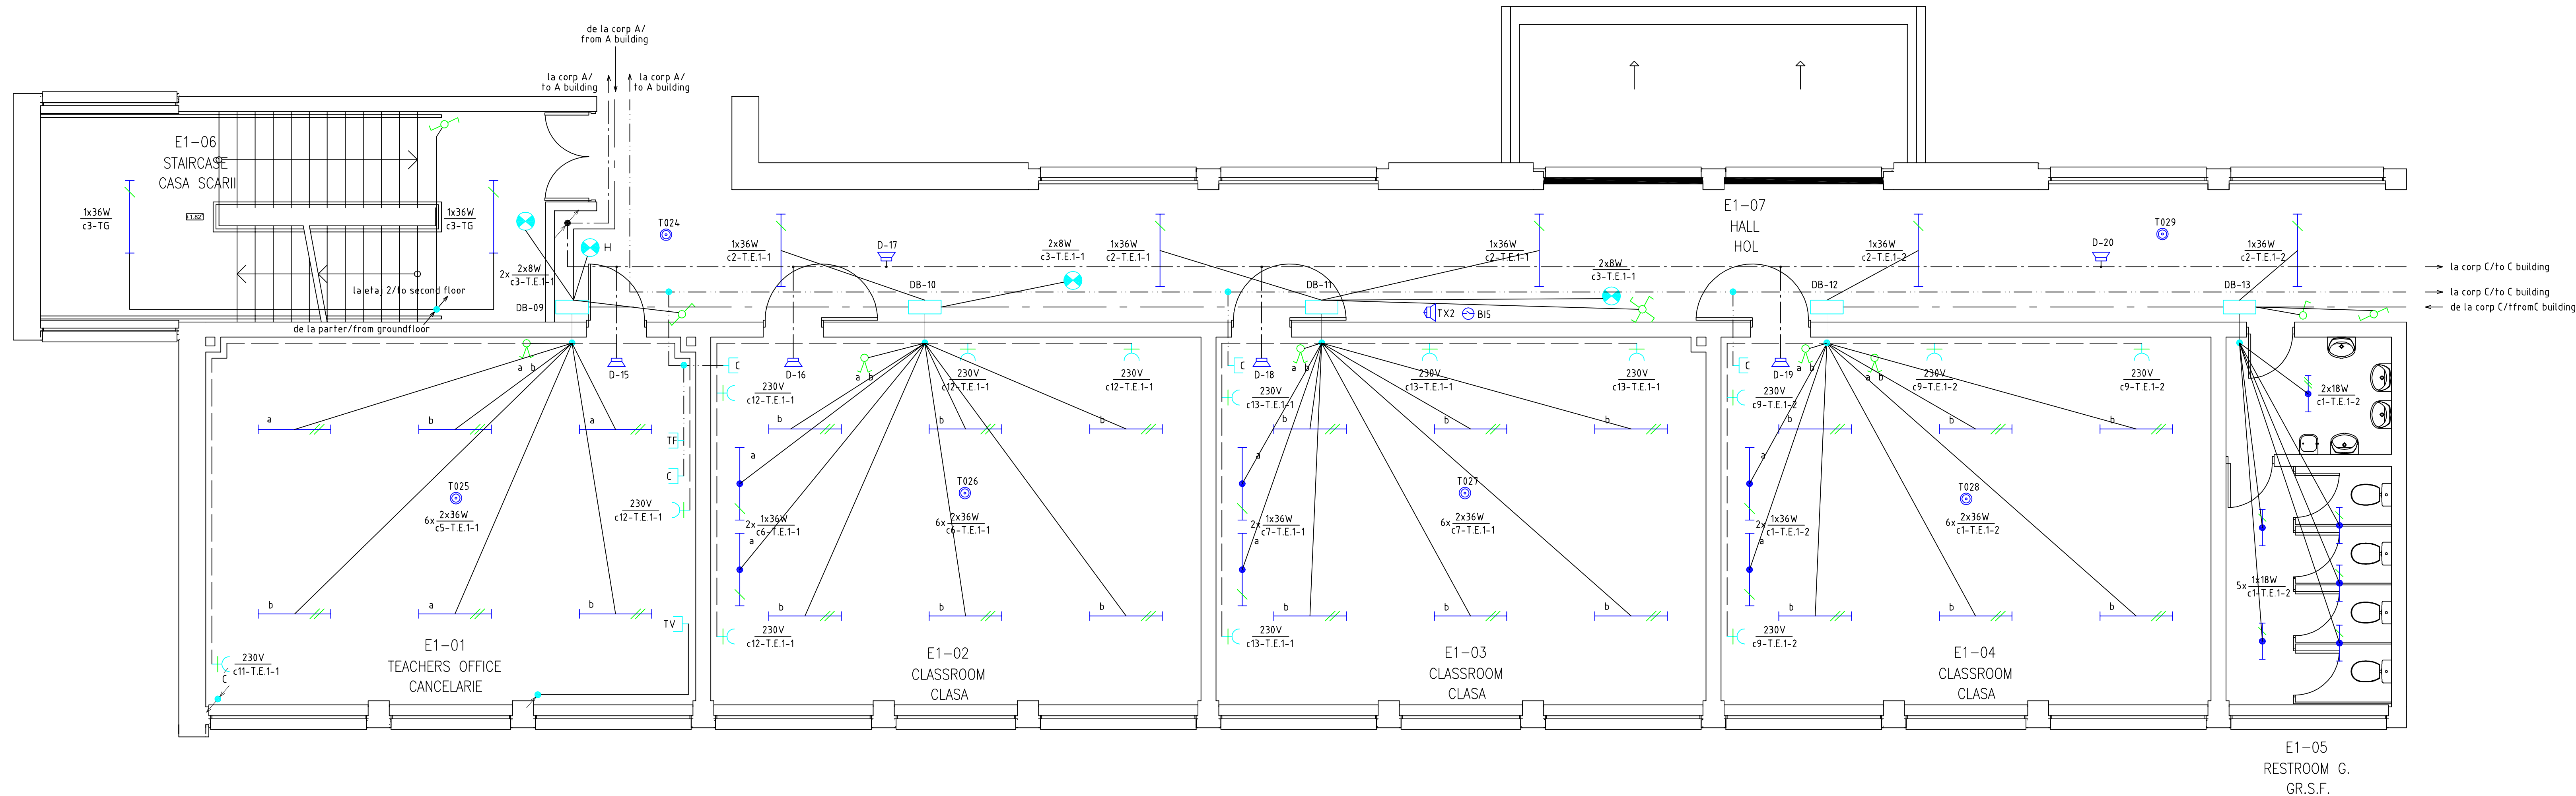

LEGENDA:

- Corp de iluminat tip aplica 1x60W
Lighting fixture bracket type 1x60W
- Corp de iluminat fluorescent 2x36W montat aparent
Fluorescent lighting fixture 2x36W apparent mounting
- Corp de iluminat fluorescent 1x36W montat aparent
Fluorescent lighting fixture 1x36W apparent mounting
- Corp de iluminat fluorescent 2x18W montat aparent, constructie etansa
Fluorescent lighting fixture 2x18W apparent mounting, water proof construction
- Corp de iluminat fluorescent 1x18W montat aparent, constructie etansa
Fluorescent lighting fixture 1x18W apparent mounting, water proof construction
- Corp de iluminat fluorescent 1x36W montat aparent, constructie etansa
Fluorescent lighting fixture 1x36W apparent mounting, water proof construction
- Corp de iluminat fluorescent 2x8W montat aparent pentru evacuare
Fluorescent lighting fixture 2x8W apparent mounting for hydrants
- Corp de iluminat fluorescent 2x8W montat aparent pentru hidranti
Fluorescent lighting fixture 2x8W apparent mounting for hydrants
- Intrerupator simplu 250V/10A
One way switch 250V/10A
- Intrerupator dublu 250V/10A
One way two poles switch 250V/10A
- Intrerupator cap scara 250V/10A
One way stair switch 250V/10A
- Intrerupator cruce 250V/10A
One way cross switch 250V/10A
- Priza 16A/230V cu contact de protectie
Socket 16A/230V with earth contact
- Priza 16A/230V cu contact de protectie, constructie etansa
Socket 16A/230V with earth contact water proof construction
- Priza telefon
Phone socket
- Priza calculator
Calculator socket
- Priza calculator
Calculator socket
- Traseu circuite montat in tub de protectie
Circuit copre mounted in protection tube
- Traseu circuite multiple
Multiple circuit
- Traseu calculator
Calculator copre
- Traseu difuzoare
Speakers copre
- Apelator telefonic/Phone
Centrala avertizare incendiu/Fire station
- Buton incendiu/Fire button
- Detector optic de fum/Optic smoke detector
- Sirena incendiu/Fire siren
- Difuzor / Speaker
- Amplificator

NOTA: ALL MEASUREMENTS SHOULD BE MADE ON SITE/TOATE MASURATORILOR SA SE FACA LA FATA LOCUULUI

VERIFICATOR VERIFICATOR VERIFICATOR	NAME NAME NAME	SERINATURA SIGNATURE SIGNATURE	CERTANTA REQUIREMENT REQUIREMENT	REFERAT / EXPERTIZA NR. / DATA REPORT / TECHNICAL EXPERTISE / DATE
PROJECT DESIGN COORDINATOR COORDINATOR PROJECT				
BUCHAREST SCHOOLS INFRASTRUCTURE REHABILITATION / REABILITAREA INFRASTRUCTURII EDUCATIONALE IN MUNICIPIUL BUCURESTI				
DESIGNER/PROTECTOR:				
<div></div>				
Municipality of Bucharest Municipality of Bucharest				
<div></div>				
SCHOOL NAME SCHOOL NAME				
General School no. 36 / Scoala Generala nr. 36				
ELECTRICAL INSTALLATION / INSTALATII ELECTRICE BUILDING "B" / CORP "B"				
1ST FLOOR PLAN PLAN ETAJ 1				
DATE / DATA	SCALE / SCARA	EXEMPLAR NR.	PROJ. PHASE / Faza proiect Detailed Design Proiect tehnic	PROJ. No. / Nr. Proiect 063/54
04/2006	1 : 50			DRWG. No. / Nr. PUNSA A - EL - 007
It is promised to copy, multiply or print this document without written approval of the LEADER BERGER GROUP, INC. Este interzis sa copiezi, sa multipliezi sau sa imprinzi acest document fara aprobarea scrisa a LEADER BERGER GROUP, INC.				